

INDUSTRIAL THERMOCOUPLES

A	CODE	HEAD EXTENSION
	1	(NO EXTENSION)
	3	NIPPLE/UNION/ (NOTE 1)

B	CONNECTION HEAD		
	CODE	MATERIAL	TYPE
	AN	ALUMINUM	WATER PROOF
SN	STAINLESS STEEL	WATER PROOF, CORROSION RESISTANT	4, 4X
AE	ALUMINUM	EXPLOSION PROOF (NOTE 2)	4
SE	STAINLESS STEEL	EXPLOSION PROOF, CORROSION RESISTANT (NOTE 2)	4, 4X
XD	ALUMINUM	EXPLOSION PROOF, FM, CSA APPROVED (NOTES 2 & 3)	4, 4X
A	CAST IRON	WEATHER PROOF, RUGGED	
AX	ALUMINUM, LARGE DEVICE, EPOXY COATED	EXPLOSION PROOF, ATEX APPROVED (NOTE 3)	4

C	CODE	CONDUIT OPENING	D	CODE	TUBE OPENING	E	CODE	"A" LENGTH
				1/2 or 3/4NPT				1/2 or 3/4NPT (NOTE 4)

F	ELEMENT CONSTRUCTION					
	CODE		DIAMETER	WIRE SIZE (AWG)	INSULATION	SPRING LOADED
	SINGLE	DUPLEX				
A14	AD14	1/4"	18	MgO-SHEATH	NO	
ASL14	ADSL14	1/4"	18	MgO-SHEATH	YES	
A516	AD516	5/16"	16	MgO-SHEATH	NO	
ASL516	ADSL516	5/16"	16	MgO-SHEATH	YES	
A38	AD38	3/8"	15	MgO-SHEATH	NO	
ASL38	ADSL38	3/8"	15	MgO-SHEATH	YES	
B14	BD14	.325"	14	CERAMIC BEAD	NO	
B08	BD08	.5"-.69"	8	CERAMIC BEAD	NO	

G	CODE		CALIBRATION
	STANDARD	SPECIAL (NOTE 5)	
	J	JJ	IRON (+) vs CONSTANTAN (-)
K	KK	CHROMEL (+) vs ALUMEL (-)	
T	TT	COPPER (+) vs CONSTANTAN (-)	
E	EE	CHROMEL (+) vs CONSTANTAN (-)	
N	NN	NICROSIL (+) vs NISIL (-)	
-	KKS	CHROMEL (+) vs ALUMEL (-) (NOTE 6)	
-	EES	CHROMEL (+) vs CONSTANTAN (-) (NOTE 6)	

H	MEASURING JUNCTION	
	G	SINGLE GROUNDED, GROUNDED TO SHEATH
	U	SINGLE UNGROUNDED, ISOLATED FROM SHEATH
	DG	DUPLEX GROUNDED, GROUNDED TO SHEATH
	DU	DUPLEX UNGROUNDED, ISOLATED FROM SHEATH

J	CODE	ELEMENT SHEATH MATERIAL	STANDARD CALIBRATIONS (NOTE 6)
	P	304 STN. STL.	J, K, T
	R	316 STN. STL.	J, K, T, E, N
	Q	310 STN. STL.	J, K, E
	J	INCONEL 600	K, N, KKS, EES (NOTE 6)

DROP CODE WHEN USING CERAMIC BEADED ELEMENTS



K	PROTECTION TUBE TYPE		
	CODE	TUBE SIZE	OD
	51	1/4" NPS	0.540
52	1/2" NPS	0.840	
53	3/4" NPS	1.050	
54	1" NPS	1.315	

L	TUBE SCHEDULE (INSIDE DIAMETER)				
	CODE	1/4"NPT	1/2"NPT	3/4"NPT	1"NPT
	40	0.364	0.622	0.824	1.049
	80	0.302	0.546	0.742	0.957
	160	N/A	0.464	0.612	0.815
XXS	N/A	N/A	0.434	0.599	

M	WELL MATERIAL	
	P	304 STAINLESS STEEL
	Q	310 STAINLESS STEEL
	R	316 STAINLESS STEEL
	PLorRL	304or316 S. S. (LOW CARBON)
	N	CARBON STEEL
	J	INCONEL 600
H	HASTELLOY C276	

N	CODE	"U" LENGTH

EXAMPLE: 3 AE $\frac{3}{4}$ - $\frac{3}{4}$ - 3 - ASL38 K G Q - 53 - 40 - Q - 36

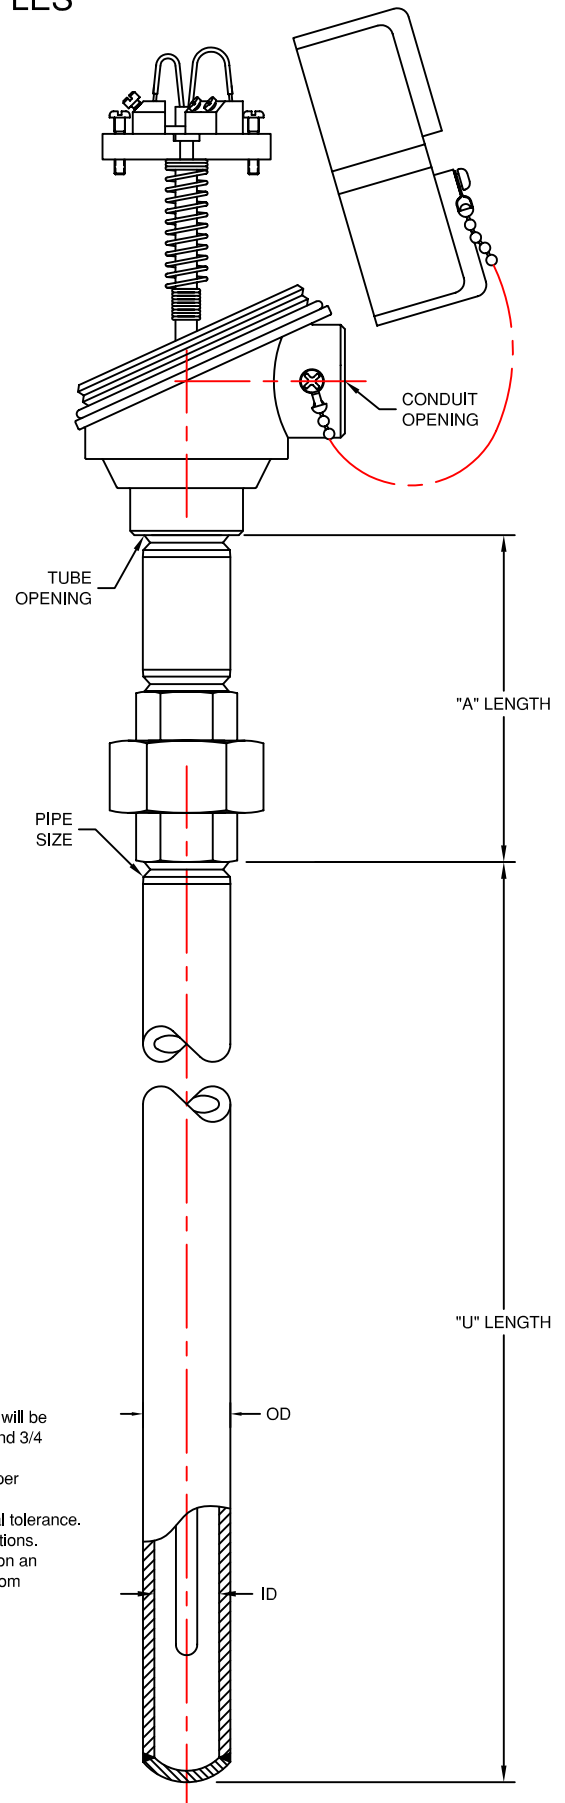

Notes:

- (1) Standard Nipples - Steel, Schedule 40.
Standard Unions - Black Malleable Iron, 150#.
OPTIONAL STAINLESS STEEL
Nipples - 304 or 316 Stainless Steel, Schedule 40 or 80.
Unions - 304 or 316 Stainless Steel.
Example Ordering Code: 3AE 3/4 1/2 6(R or R80).
- (2) Rated NEC class 1, Groups B, C and D.
- (3) ATEX approved EEx d IIC, T6.
- (4) For 1/4" and 1" pipe size a reducing bushing or enlarger will be used to fit tube opening, specify 1/2 for 1/4" pipe size and 3/4 for 1" pipe size.
- (5) Meets or exceeds Special Initial Calibration Tolerances per ANSI MC96.1-1982 and ASTM E230-1993
- (6) KKS & EES denotes stabilized thermocouple and special tolerance.
- (7) Contact factory for other calibration and sheath combinations.
- (8) For an item that does not fall within the catalog description an (SP) can be added to the ordering code as part of a custom construction.



TEMPERATURE MEASUREMENT DESIGNER'S GUIDE
WWW.THERMO-ELECTRIC-DIRECT.COM

SECTION INTC

PIPE WELL ASSEMBLIES PLAIN CONSTRUCTION

The information contained hereon shall be considered the sole property of Thermo Electric Company, Inc. The recipient thereof agrees not to disclose or reproduce said information to parties outside the recipient's organization without the written permission of Thermo Electric.

Doc. No.: TE-CO010109-INTC-120